


# Sampling Results for Lead in University Park

Sampling results below are provided from samples collected by customers at approximately 40 homes and businesses in the University Park area. These locations were identified by Aqua and approved by the Illinois Environmental Protection Agency as official test sites. Samples are collected after the water sat in plumbing pipes for more than 6 hours to represent a worst-case scenario.

The EPA standard states that 90% of the sample results should be below a lead concentration of 15 micrograms per liter (ug/L) in drinking water.

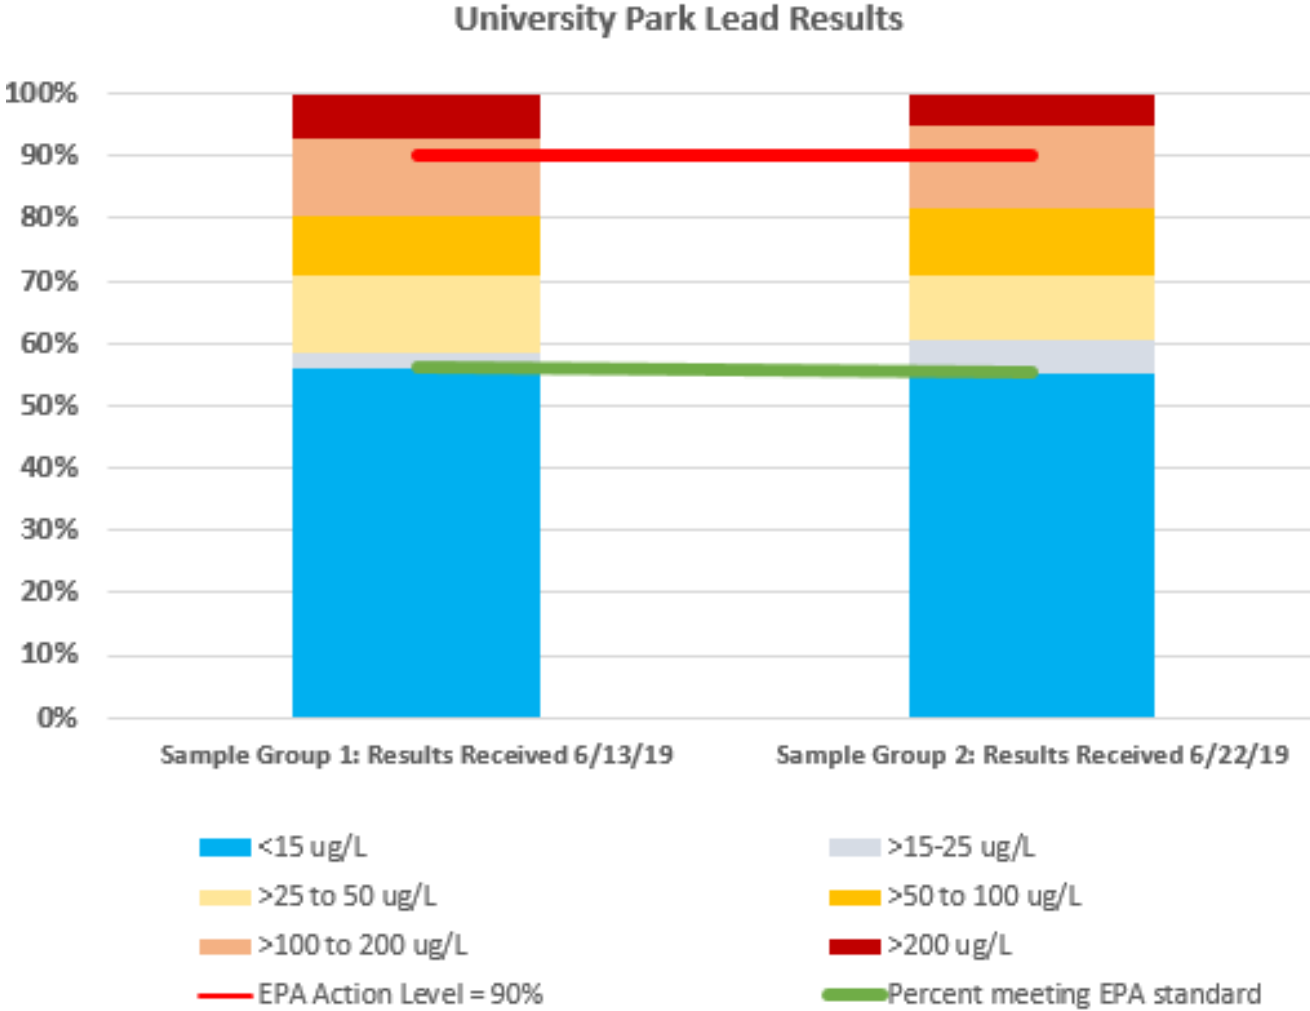

## Lead Sampling Results for University Park Sampling Events

The table below represents lead sampling results from Sample Group 1 collected in May 2019 as part of our biannual required sampling, and subsequent sample groups. We are now conducting weekly testing because of the lead issue. As we receive additional weekly sample results, we will add them to the table. Please note, not all results may be available in the table below for each sample group, because we may receive samples back from customers or results from the lab on different days. The table will be updated weekly and will include results as they become available. To maintain privacy of individual owners, we have identified each sample with a Home ID rather than actual street address.

Home ID	Year Built	LEAD CONCENTRATION (ug/L)	
		Sample Group 1: First Results Received 6/13/19	Sample Group 2: First Results Received 6/22/19
1	1970	110	150
2	1970	<1.0	*
3	1970	1.3	1.3
4	1970	<1.0	4.1
5	1970	1.3	<1.0
6	1970	<1.0	<1.0
7	1970	66	620
8	1970	14	2.5
9	1970	<1.0	<1.0
10	1970	92	480
11	1972	<1.0	1.4
12	1972	<1.0	<1.0
13	1973	23	19
14	1973	31	38
15	1973	3.5	5.1
16	1973	670	140
17	1973	170	25
18	1973	140	160
19	1974	280	130

		LEAD CONCENTRATION (ug/L)	
Home ID	Year Built	Sample Group 1: First Results Received 6/13/19	Sample Group 2: First Results Received 6/22/19
20	1974	88	35
21	1975	110	62
22	1975	2.8	*
23	1975	46	42
24	1975	180	130
25	1975	7.9	<1.0
26	1975	6.2	<1.0
27	1975	66	44
28	1975	41	3.2
29	1975	29	51
30	1975	1.0	<1.0
31	1975	9.7	9.2
32	1975	35	54
33	1975	1700	77
34	1979	1.9	<1.0
35	1990	<1.0	1.3
36	1996	<1.0	<1.0
37	1998	1.7	<1.0
38	2002	<1.0	<1.0
39	2006	<1.0	*
40	2008	<1.0	<1.0
41	2007	<1.0	1.1

\* Property did not return sample

	<b>Parameter</b>	<b>Sample Group 1: First Results Received 6/13/19</b>	<b>Sample Group 2: First Results Received 6/22/19</b>
<b>Concentration Statistics in ug/L</b>	Minimum	<1.0	<1.0
	Maximum	1700	620
	Average	96.1	60.5
	Median	7.9	4.6
	Sample Count	41	38